




CONTROLLED




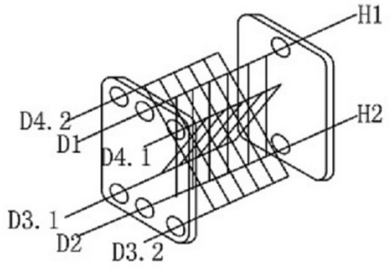


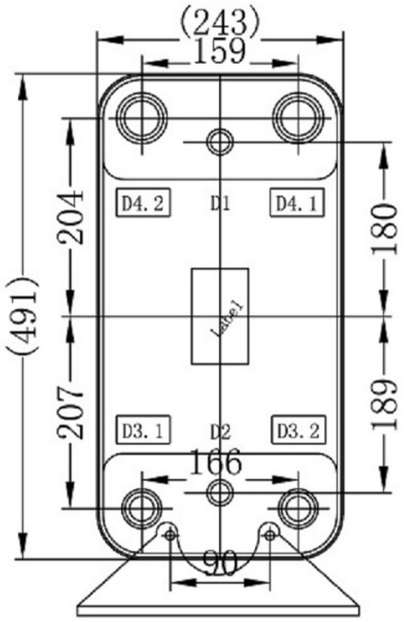


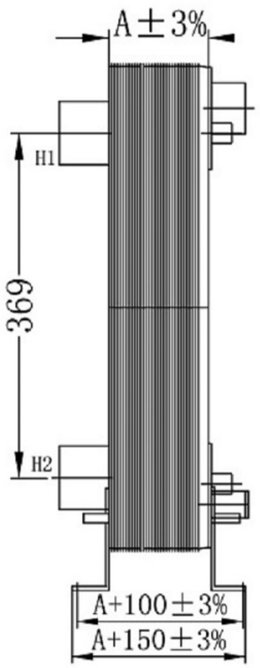

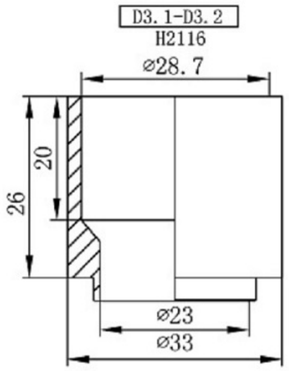

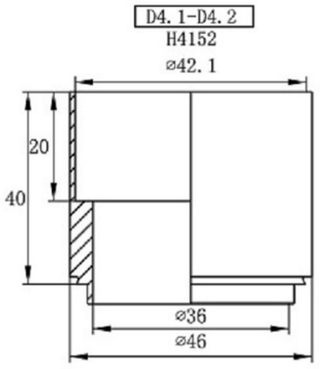

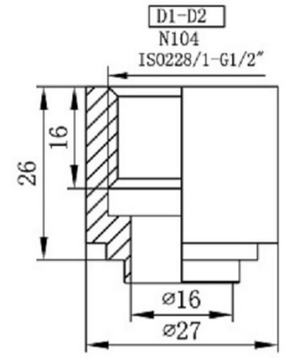

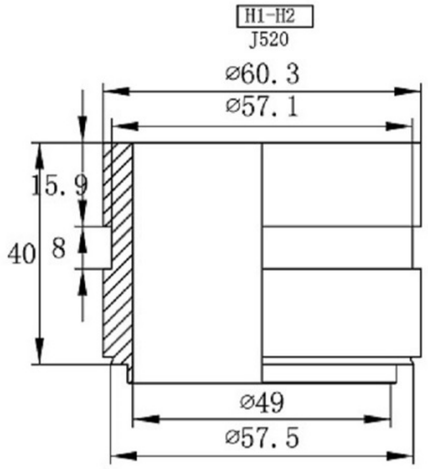

Item	Model	Description	A
1	HBL100DE-62	N104-D1-D2,H2116-D3.1-D3.2,H4152-D4.1-D4.2,J520-H1-H2	136
2	HBL100DE-82	N104-D1-D2,H2116-D3.1-D3.2,H4152-D4.1-D4.2,J520-H1-H2	176
3	HBL100DE-102	N104-D1-D2,H2116-D3.1-D3.2,H4152-D4.1-D4.2,J520-H1-H2	217

备注：加底脚

	DESIGN DATA
DESIGN PRESSURE	4.5MPa
TEST PRESSURE	6.75MPa
DESIGN TEMPERATURE	-196/+225
LEAKAGE TEST	He检
PLATE MATERIAL	316L
PIPE MATERIAL	304
FRAME MATERIAL	304

修改号	修改日期	修改内容	修改人员

Assembly drawing

DEPARTMENT	Sales Department	DATE	SCALE	BAODE HEAT EXCHANGER 宝得换热
DESIGNER	JLN	2022/04/20		MODEL HBL100EW
INSPECTOR	ZJF			
APPROVAL	FL		DRAWING NO.	2305144 REV 0